## **Profile/Photo Observation Report**



Date: 04/15/2018 Weather: **PACP 6.0** Coding: Pipe Length (ft): 253.2 Owner: NA Pre Clean: **Not Known** P.O.#: Surveyor: PSR: P-904-015-014 Selasie Honu

Customer: Clean Date: 01/01/1900 Shape: C

Street: FRASER LN Flow Control: Not Controlled
City: Hobart, IN Year Renewed:

Location: Other Tape/Media #:
Purpose: Not Known Dia/Height:

Purpose: Not Known Dia/Height: 10"
Use: Sanitary Material: VCP

Drain Area: NA Lining: Category: NA

Category: NA
Comment:

Location Details: Direction of Survey: **Upstream** 

US MH: M-904-015 DS MH: M-904-014 Total Length Surveyed (ft): 224.6

2.94 3B21 53.00 O&M Index: O&M Quick: O&M Rating: 2.05 312B 39.00 Structural Quick: Structural Rating: Structural Index: 2.49 **3B2B** 92.00 Overall Index: Overall Quick: Overall Rating:

904-01		Code	Observation	Video (sec)	Grade
	4				
	.0	AMH	Manhole	10	NA
	.0	MWL	Water Level	21	NA
	2.3	FL	Fracture Longitudinal	37	S 3
	48.3	MWLS(S01)	Water Level Sag	140	S 2
	59.8	TF	Tap Factory	177	NA
<del>-</del>	102.6	MWLS(F01)	Water Level Sag	276	S 2
	120.8	MWLS	Water Level Sag	323	S 2
	128.1	MWLS	Water Level Sag	349	S 2
	132.2	MWLS(S02)	Water Level Sag	369	S 2
	136.5	TF	Tap Factory	390	NA
	138.7	TF	Tap Factory	411	NA
	144.6	MWLS(F02)	Water Level Sag	436	S 2
	173.2	FC	Fracture Circumferential	504	S 2
	199.6	MWLS	Water Level Sag	568	S 2
	201.1	MWLS	Water Level Sag	583	S 2
	202.8	IW	Infil Weeper	598	M 2
	209.3	TFA	Tap Factory Active	622	NA
	224.6	AMH	Manhole	664	NA

Code:



Description:	Manhole
Distance (ft): Structural Grade:	.0 0
O&M Grade: Clock Start/From:	0
Clock To:  1st Value:	
2nd Value: Value Percent:	
Continuous Index: Within 8" of Joint: Remarks:	NO M-904-014

**AMH** 



Code: MWL

Description: **Water Level** 

Distance (ft): .0 Structural Grade: 0 O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent:

Continuous Index:

Within 8" of Joint: NO

Remarks:

5.000




Code: FL

Description: **Fracture Longitudinal** 

Distance (ft): 2.3 Structural Grade: 3 O&M Grade: 0 Clock Start/From: 3 Clock To: 1st Value: 2nd Value:

Value Percent: Continuous Index:

Within 8" of Joint: NO

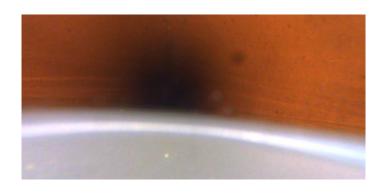

Description: Water Level Sag

Distance (ft): 48.3
Structural Grade: 2
O&M Grade: 3

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 15.000
Continuous Index: S01
Within 8" of Joint: NO

Remarks:

Code: **TF** 

Description: Tap Factory



Distance (ft): 59.8
Structural Grade: 0

O&M Grade: 0

Clock Start/From: 10

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:



Description: Water Level Sag

Distance (ft): 102.6
Structural Grade: 2
O&M Grade: 3

Clock Start/From: Clock To: 1st Value: 2nd Value:

Value Percent: 15.000
Continuous Index: F01
Within 8" of Joint: NO

Remarks:

Code: MWLS

Description: Water Level Sag



Distance (ft): 120.8 Structural Grade: 2

O&M Grade: 3


Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 15.000

Continuous Index:

Within 8" of Joint: NO

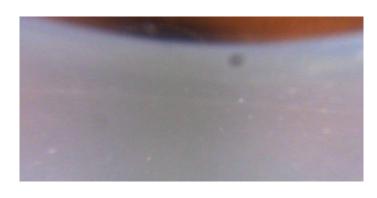

Description: Water Level Sag

Distance (ft): 128.1
Structural Grade: 2
O&M Grade: 3

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 15.000

Continuous Index:

Within 8" of Joint:

Remarks:

NO



Code: MWLS


Description: Water Level Sag

Distance (ft): 132.2
Structural Grade: 2
O&M Grade: 3

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 15.000
Continuous Index: S02
Within 8" of Joint: NO

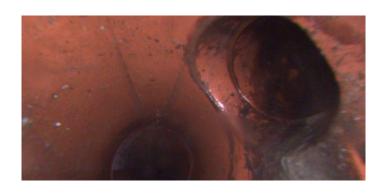

Code: **TF** 

Description: Tap Factory

Distance (ft): 136.5
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 10

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:



Code: **TF** 

Description: Tap Factory

Distance (ft): 138.7
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 2

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Description: Water Level Sag



Distance (ft): 144.6
Structural Grade: 2
O&M Grade: 3

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 15.000
Continuous Index: F02
Within 8" of Joint: NO

Remarks:

Code: FC

Description: Fracture Circumferential



Distance (ft): 173.2
Structural Grade: 2
O&M Grade: 0
Clock Start/From: 9
Clock To: 11

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: YES

Description: Water Level Sag

Distance (ft): 199.6
Structural Grade: 2
O&M Grade: 3

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent:

10.000

Continuous Index:

Within 8" of Joint:

NO

Remarks:

Code: MWLS

Description: Water Level Sag

Distance (ft): 201.1
Structural Grade: 2
O&M Grade: 3

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 10.000

Continuous Index:

Within 8" of Joint: NO



Code: Description: IW

Infil Weeper




Distance (ft): 202.8
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 7
Clock To: 5

1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES

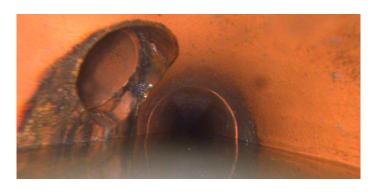

Code: TFA

Description: Tap Factory Active

Distance (ft): 209.3
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 10

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:



Code: AMH
Description: Manhole

Distance (ft): 224.6
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO

Remarks: M-904-015