Profile/Photo Observation Report



Date: 10/04/2018 Weather: **PACP 6.0** Coding: Pipe Length (ft): 329.6 Owner: NA Pre Clean: **Not Known** P.O.#: **Justin Gonzales** PSR: P-904-061-060 Surveyor:

Customer: Clean Date: 01/01/1900 Shape: C

Street: Division St. Flow Control: Not Controlled

City: Hobart, IN Year Renewed:
Location: Light Highway Tape/Media #:

Purpose: Routine Assessment Dia/Height: 10"
Use: Sanitary Material: VCP

Drain Area: **NA** Lining:

Category: NA

Comment:

Location Details: Direction of Survey: Upstream

US MH: M-904-061 DS MH: M-904-060 Total Length Surveyed (ft): 326.8

2.00 2H00 98.00 O&M Index: O&M Quick: O&M Rating: 0.00 0000 0.00 Structural Quick: Structural Rating: Structural Index: 2.00 2H00 98.00 Overall Index: Overall Quick: Overall Rating:

	Position	Code	Observation	Video (sec)	Grade
904	060				
	0.	AMH	Manhole	10	NA
ш	0.	MWL	Water Level	21	NA
	25.6	TFA	Tap Factory Active	84	NA
ш	30.9	IS	Infil Stain	107	NA
н	35.4	IS	Infil Stain	128	NA
П	67.9	TF	Tap Factory	204	NA
П	82.8	DAGS(S01)	Deposits Attached Grease	246	M 2
ш	181.7	TF	Tap Factory	455	NA
н	289.6	TF	Tap Factory	683	NA
н	326.8	DAGS(F01)	Deposits Attached Grease	769	M 2
ш	326.8	AMH	Manhole	780	NA
]				

Code:

Description:



.0
0
0
NO
M-904-060

AMH

Manhole



Code: MWL

Description: **Water Level**

Distance (ft): .0 Structural Grade: 0 O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent:

Continuous Index:

Within 8" of Joint:

Remarks:

5.000

NO

Code: Description:

TFA

6.000

Tap Factory Active




Distance (ft): 25.6 Structural Grade: 0 O&M Grade: 0 Clock Start/From: 9

Clock To:

1st Value:

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:

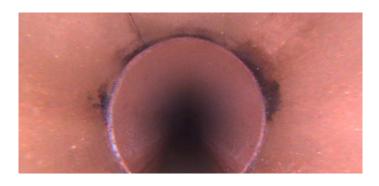

Code: IS

Description: Infil Stain

Distance (ft): 30.9

Structural Grade: 0

O&M Grade: 0

Clock Start/From: 9

Clock To: 3

1st Value: 2

2nd Value: Value Percent:

Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: IS

Description: Infil Stain

Distance (ft): 35.4
Structural Grade: 0

O&M Grade: 0

Clock Start/From: 11

Clock To: 3


1st Value: 2

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES

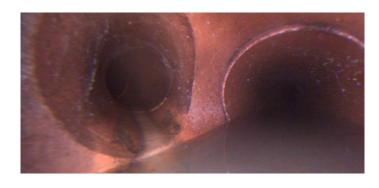

Code: **TF**

Description: Tap Factory

Distance (ft): 67.9
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 9

Clock To:

1st Value:

6.000

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:

2nd Value:




Code: DAGS

Description: Deposits Attached Grease

Distance (ft): 82.8
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 7
Clock To: 5
1st Value:

Value Percent: 5.000
Continuous Index: S01
Within 8" of Joint: YES

Remarks: WANDER

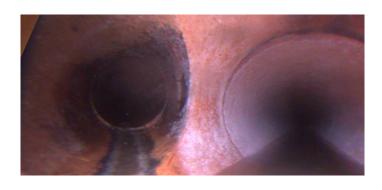

Code: **TF**

Description: Tap Factory

Distance (ft): 181.7
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 9

Clock To:

1st Value: **6.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:



Code: **TF**

Description: Tap Factory

Distance (ft): 289.6
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 9

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:



Code: DAGS

Description: Deposits Attached Grease

Distance (ft): 326.8
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 7
Clock To: 5

1st Value: 2nd Value:

Value Percent: 5.000
Continuous Index: F01
Within 8" of Joint: YES

Remarks: WANDER



Code: AMH
Description: Manhole

Distance (ft): 326.8
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: NO

Remarks: M-904-061