Profile/Photo Observation Report



Date: 10/04/2018 Weather: **PACP 6.0** Coding: Pipe Length (ft): 285.4 Owner: NA Pre Clean: **Not Known** P.O.#: **Justin Gonzales** PSR: P-904-072-063 Surveyor:

Customer: Clean Date: 01/01/1900 Shape: C

Street: Shelby St. Flow Control: Not Controlled

City: Hobart, IN Year Renewed:
Location: Light Highway Tape/Media #:

Purpose: Routine Assessment Dia/Height: 8"
Use: Sanitary Material: VCP

Drain Area: **NA** Lining:

Category: NA

Comment:

Location Details: Direction of Survey: **Downstream**

US MH: M-904-063 DS MH: M-904-072 Total Length Surveyed (ft): 287.1

2.00 2100 106.00 O&M Index: O&M Quick: O&M Rating: 2.00 2100 2.00 Structural Quick: Structural Rating: Structural Index: 2.00 2100 108.00 Overall Rating: Overall Index: Overall Quick:

	Position	Code	Observation	Video (sec)	Grade
904-063					
). /	0	AMH	Manhole	10	NA
\	D	MWL	Water Level	21	NA
2	0.4	DAGS(S01)	Deposits Attached Grease	73	M 2
4	1.4	MWL	Water Level	127	NA
6	4.8	TFC	Tap Factory Capped	185	NA
6	9.5	MWL	Water Level	207	NA
1	.13.8	CL	Crack Longitudinal	307	S 2
/1	.14.2	ТВ	Tap Break-in	320	NA
$ / \overline{1}$.40.4	IS	Infil Stain	384	NA
$ \sqrt{1}$.47.2	TFC	Tap Factory Capped	409	NA
$\frac{1}{\sqrt{1}}$.63.2	IS	Infil Stain	453	NA
///1	.83.4	IS	Infil Stain	505	NA
$1/\sqrt{2}$	30.9	TFC	Tap Factory Capped	611	NA
//[2	41.4	IS	Infil Stain	644	NA
/ /2	46.6	RPR	Repair Point Pipe Replaced	666	NA
- 1/2	49.7	TF	Tap Factory	684	NA
<u> </u>	59.2	TF	Tap Factory	716	NA
	87.1	DAGS(F01)	Deposits Attached Grease	784	M 2
	87.1	AMH	Manhole	795	NA

Code:

Description:



Distance (ft): .0 Structural Grade: 0 O&M Grade: 0 Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: NO Remarks: M-904-063

AMH

Manhole



Code: MWL

Description: Water Level

Distance (ft): .0
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent:

Continuous Index:

Within 8" of Joint:

Remarks:

5.000

NO



Code: DAGS

Description: Deposits Attached Grease

Distance (ft): 20.4
Structural Grade: 0

O&M Grade: 2

Clock Start/From: 7

Clock To: 5

1st Value:

2nd Value:

Value Percent: 5.000
Continuous Index: S01
Within 8" of Joint: YES
Remarks: WANDER



Code: MWL

Description: Water Level

Distance (ft): 41.4
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 10.000

Continuous Index:

Within 8" of Joint:

Remarks:

NO



Code: **TFC**

Description: Tap Factory Capped

Distance (ft): 64.8
Structural Grade: 0

O&M Grade: 0

Clock Start/From: 3

Clock To:

1st Value: **6.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:



Code: MWL

Description: Water Level

Distance (ft): 69.5
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:


Value Percent: 15.000

Continuous Index:

Within 8" of Joint:

Remarks:

NO

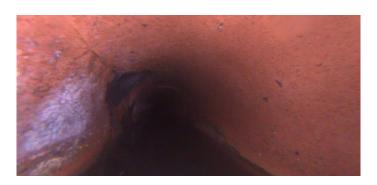


Code: CL

Description: Crack Longitudinal

Distance (ft): 113.8
Structural Grade: 2
O&M Grade: 0
Clock Start/From: 10

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

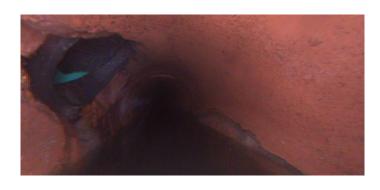

Code: TB

Description: Tap Break-in

4.000

Distance (ft): 114.2
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 10

Clock To:

1st Value:

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:

Code: IS

Description: Infil Stain



Distance (ft): **140.4**

Structural Grade: 0


O&M Grade: 0

Clock Start/From: 7

Clock To: 10

1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES

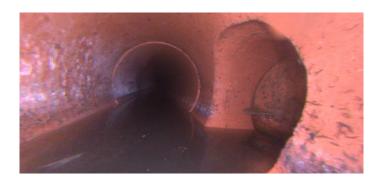

Code: TFC

Description: Tap Factory Capped

Distance (ft): 147.2
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 3

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:



Code: IS

Description: Infil Stain

Distance (ft): 163.2
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 10
Clock To: 3
1st Value:
2nd Value:

Value Percent: Continuous Index:

Within 8" of Joint: YES



Code: IS

Description: Infil Stain

Distance (ft): 183.4
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 11
Clock To: 5

1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: **TFC**


Description: Tap Factory Capped

Distance (ft): 230.9
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 3

Clock To:

1st Value: **6.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

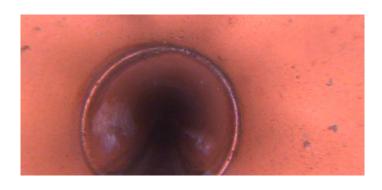

Code: IS

Description: Infil Stain

Distance (ft): 241.4
Structural Grade: 0

O&M Grade: 0

Clock Start/From: 11

Clock To: 4

1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES

Remarks:



Code: RPR

Description: Repair Point Pipe Replaced


Distance (ft): 246.6
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: NO Remarks: PVC

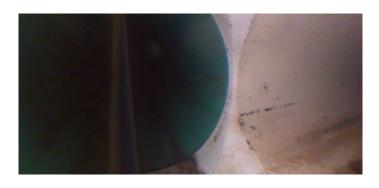

Code: **TF**

Description: Tap Factory


Distance (ft): 249.7
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 9

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:

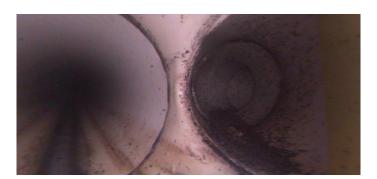

Code: **TF**

Description: Tap Factory

Distance (ft): 259.2
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 3

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:



Code: DAGS

Description: Deposits Attached Grease

Distance (ft): 287.1
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 7
Clock To: 5

1st Value: 2nd Value:

Value Percent: 5.000
Continuous Index: F01
Within 8" of Joint: YES

Remarks: WANDER



Code: AMH
Description: Manhole

Distance (ft): 287.1
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO

Remarks: M-904-072