Profile/Photo Observation Report



Date: 12/21/2024 Weather: **PACP 7.0** Coding: Pipe Length (ft): 164.0 Owner: **City of Hobart** Pre Clean: **Heavy Cleaning** P.O.#: S. Bucklin PSR: P-904-067-071 YES502259 Surveyor:

Customer: City of Hobart Clean Date: 11/25/2024 Shape: C

Street: Pembroke Drive North Flow Control: Not Controlled

City: Hobart, IN Year Renewed:
Location: Easement/Right of Way Tape/Media #:

Purpose: Sewer System Evaluation Survey (SS Dia/Height: 8"
Use: Sanitary Sewage Pipe Material: PVC
Drain Area: Lining: None

Category: NA


Comment:

Location Details: Direction of Survey: **Downstream**

US MH: M-904-067 DS MH: M-904-071 Total Length Surveyed (ft): 165.4

2.33 3122 7.00 O&M Index: O&M Quick: O&M Rating: 2.63 4439 71.00 Structural Rating: Structural Index: Structural Quick: 2.60 78.00 Overall Index: Overall Quick: Overall Rating:

	Position	Code	Observation	Video (sec)	Grade
904-0	067				
-	0.	AMH	Manhole	0	NA
+	0.	MWL	Miscellaneous Water Level	73	NA
H	7.2	MWLS(S01)	Miscellaneous Water Level Sag	121	S 2
+	13.8	IWB	Infiltration Weeper Barrel	209	M 2
	14.2	TBI	Tap Break-in Intruding	225	M 2
	21.5	MWLS(F01)	Miscellaneous Water Level Sag	276	S 2
	26.9	MWLS(S02)	Miscellaneous Water Level Sag	302	S 2
	32.4	MWLS(F02)	Miscellaneous Water Level Sag	331	S 2
ш	36.8	MWLS(S03)	Miscellaneous Water Level Sag	362	S 2
+	42.9	JAL	Joint Angular Large	427	S 4
	44.4	TF	Tap Factory	454	NA
ш	46.0	TF	Tap Factory	480	NA
+	46.5	JSL	Joint Separated Large	533	S 4
ш	\\\ <u>\</u> 63.8	MWLS(F03)	Miscellaneous Water Level Sag	621	S 2
+	69.2	MWLS(S04)	Miscellaneous Water Level Sag	650	S 2
+	83.8	MWLS(F04)	Miscellaneous Water Level Sag	716	S 2
ш	98.7	MWLS(S05)	Miscellaneous Water Level Sag	787	S 3
ш	104.3	FM	Fracture Multiple	878	S 4
ш	104.8	TBD	Tap Break-in/Hammer Defective	898	M 3
ш	138.9	JSL	Joint Separated Large	1196	S 4
+	146.2	MWLS(F05)	Miscellaneous Water Level Sag	1263	S 3
-	156.8	MWLS(S06)	Miscellaneous Water Level Sag	1328	S 2
	165.4	MWLS(F06)	Miscellaneous Water Level Sag	1499	S 2
	165.4	AMH	Manhole	1523	NA

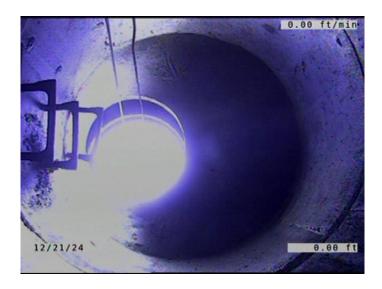

Code: AMH
Description: Manhole

Distance (ft): .0
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO

Remarks: M-904-067



Code: MWL

Description: Miscellaneous Water Level

Distance (ft): .0
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 5.000

Continuous Index:

Within 8" of Joint: NO



Description: Miscellaneous Water Level Sag

Distance (ft): 7.2
Structural Grade: 2
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 15.000
Continuous Index: S01
Within 8" of Joint: NO

Remarks:



Code: IWB

Description: Infiltration Weeper Barrel

Distance (ft): 13.8 Structural Grade: 0 O&M Grade: 2 Clock Start/From: 12 Clock To: 1 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: NO

ieiiii o oi soiiie.



Code: **TBI**

Description: Tap Break-in Intruding

Distance (ft): 14.2
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 2

Clock To:

 1st Value:
 6.000

 2nd Value:
 2.000

Value Percent:

Continuous Index:

Within 8" of Joint: NO
Remarks: Active



Code: MWLS

Description: Miscellaneous Water Level Sag

Distance (ft): 21.5
Structural Grade: 2
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 15.000
Continuous Index: F01
Within 8" of Joint: NO



Description: Miscellaneous Water Level Sag

Distance (ft): 26.9
Structural Grade: 2
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 10.000
Continuous Index: S02
Within 8" of Joint: NO

Remarks:



Code: MWLS

Description: Miscellaneous Water Level Sag

Distance (ft): 32.4
Structural Grade: 2
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 10.000
Continuous Index: F02
Within 8" of Joint: NO



Description: **Miscellaneous Water Level Sag**

Distance (ft): 36.8 Structural Grade: 2 0 O&M Grade:

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 15.000 Continuous Index: **S03** Within 8" of Joint: NO

Remarks:



JAL Code:


Description: **Joint Angular Large**

Distance (ft): 42.9 Structural Grade: 4 O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES

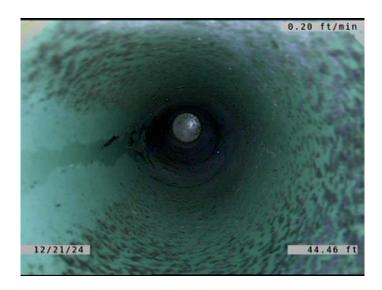

Code: **TF**

Description: Tap Factory

Distance (ft): 44.4
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 11

Clock To:

1st Value: **6.000**

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

NO



Code: TF

Description: Tap Factory

Distance (ft): 46.0
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 1

Clock To:

1st Value: **6.000**

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO



Code: JSL

Description: **Joint Separated Large**

46.5 Distance (ft): Structural Grade: 4 0 O&M Grade:


Clock Start/From: Clock To:

1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES

JOINT/ PIPES NOT PUSHED ALL THE Remarks:

WAY TOGETHER WHEN THEY WERE I

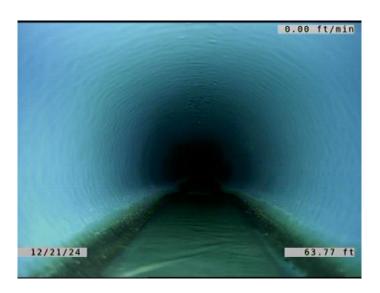

Code: **MWLS**


Description: **Miscellaneous Water Level Sag**

Distance (ft): 63.8 Structural Grade: 2 O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 15.000 Continuous Index: F03 Within 8" of Joint: NO

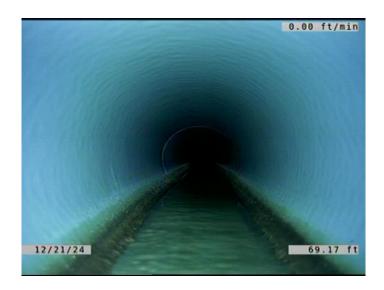

Description: Miscellaneous Water Level Sag

Distance (ft): 69.2
Structural Grade: 2
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 10.000
Continuous Index: S04
Within 8" of Joint: NO

Remarks:



Code: MWLS

Description: Miscellaneous Water Level Sag

Distance (ft): 83.8
Structural Grade: 2
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 10.000
Continuous Index: F04
Within 8" of Joint: NO



Description: Miscellaneous Water Level Sag

Distance (ft): 98.7
Structural Grade: 3
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 50.000
Continuous Index: S05
Within 8" of Joint: NO

Remarks:



Code: FM

Description: Fracture Multiple

Distance (ft): 104.3
Structural Grade: 4
O&M Grade: 0
Clock Start/From: 12
Clock To: 2
1st Value:
2nd Value:

Value Percent: Continuous Index:

Within 8" of Joint: NO



Code: TBD

Description: Tap Break-in/Hammer Defective

Distance (ft): 104.8
Structural Grade: 0
O&M Grade: 3
Clock Start/From: 12

Clock To:

1st Value: **6.000**

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO

Remarks: **CONSTANTLY RUNNING WATER.**

SERVICE IS COMING FROM THE LEFT



Code: JSL

Description: Joint Separated Large

Distance (ft): 138.9
Structural Grade: 4
O&M Grade: 0

Clock Start/From:

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: YES

Remarks: **JOINT/ PIPES NOT PUSHED TOGETHER WHEN INSTALLED.**



Description: Miscellaneous Water Level Sag

Distance (ft): 146.2
Structural Grade: 3
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 50.000
Continuous Index: F05
Within 8" of Joint: NO

Remarks:



Code: MWLS

Description: Miscellaneous Water Level Sag

Distance (ft): 156.8
Structural Grade: 2
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 10.000
Continuous Index: S06
Within 8" of Joint: NO



Description: Miscellaneous Water Level Sag

Distance (ft): 165.4
Structural Grade: 2
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 10.000
Continuous Index: F06
Within 8" of Joint: NO

Remarks:



Code: AMH
Description: Manhole

Distance (ft): 165.4
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: NO

Remarks: **M-904-071**