

Date:	02/03/2023	Weather:		Coding:	PACP 7.0
Pipe Length (ft)	: <b>268.0</b>	Owner:	City of Hobart	Pre Clean:	No Pre-Cleaning
P.O.#:	YES502259	Surveyor:	S. Bucklin	PSR:	P-905-001-003
Customer:	City of Hobart	Clean Date:		Shape:	С
Street:	State Road 130		Flow Control:	Not Controlle	d
City:	Hobart, IN		Year Renewed:		
Location:	Easement/Right o	f Way	Tape/Media #:		
Purpose:	Routine Assessme	ent	Dia/Height:	18"	
Use:	Sanitary Sewage F	Pipe	Material:	PVC	
Drain Area:			Lining:	None	
Category:	NA				
Comment:					
Location Details	s:		Direction of Surve	ey: Downstream	
US MH:	M-905-003	DS MH:	M-905-001	Total Length Surveyed (f	t): 268.8
D&M Index:	2.00	O&M Quick:	2H00	O&M Rating:	94.00
Structural Index:	0.00	Structural Qu	uick: 0000		. 0.00
Overall Index:	2.00	Overall Quicl			94.00



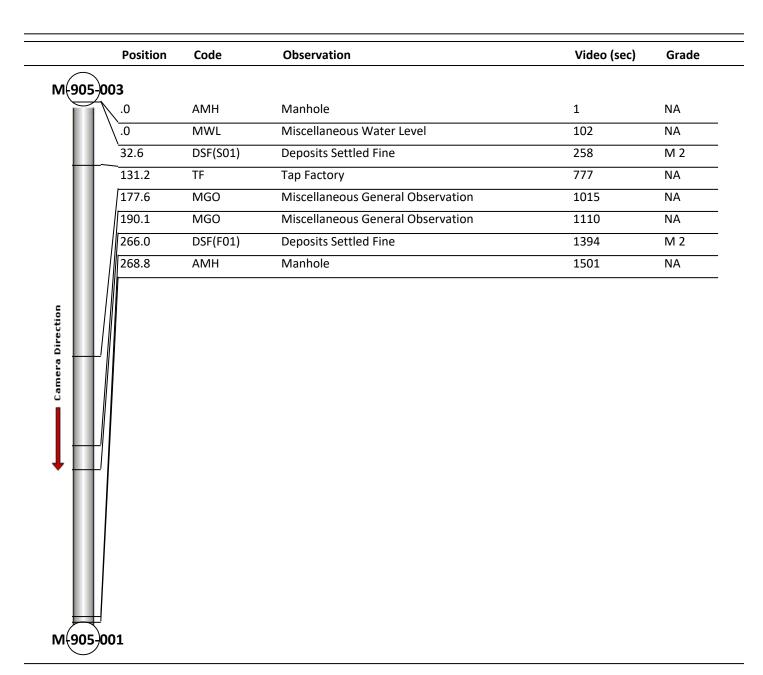

Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-905-003

Tuesday, April 25, 2023

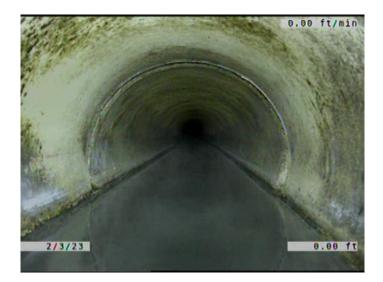

Code:	MWL
Description:	Miscellaneous Water Level
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	15.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code: Description:	DSF Deposits Settled Fine
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent:	32.6 0 2 5 7 10.000
Continuous Index: Within 8" of Joint: Remarks:	SO1 YES



Code:	TF
Description:	Tap Factory
Distance (ft):	131.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	12
Clock To: 1st Value: 2nd Value: Value Percent:	6.000
Continuous Index: Within 8" of Joint: Remarks:	YES



Description:	
Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	177.6 0 0 NO JOINT/ PIPES NOT PUSHED ALL THE WAY TOGETHER WHEN INSTALLED



Code: MGO Description: **Miscellaneous General Observation** Distance (ft): 190.1 Structural Grade: 0 0 O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: NO Remarks: JOINT/ PIPES NOT PUSHED ALL THE WAY TOGETHER WHEN INSTALLED



Code: Description:	DSF Deposits Settled Fine
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value:	266.0 0 2 5 7
Value Percent: Continuous Index: Within 8" of Joint: Remarks:	10.000 F01 YES



Code: Description:	AMH Manhole
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	268.8 0 0 NO M-905-001