

Profile/Photo Observation Report





Date:	09/10/2022	Weather:		Coding:	PACP 7.0
Pipe Length (ft):	315.0	Owner:	City of Hobart	Pre Clean:	Heavy Cleaning
P.O.#:	YES502259	Surveyor:	S. Bucklin	PSR:	P-907-009-UNK
Customer:	City of Hobart	Clean Date:	08/22/2022	Shape:	C

Street:	South Union Street	Flow Control:	Not Controlled
City:	Hobart, IN	Year Renewed:	
Location:	Ditch	Tape/Media #:	
Purpose:	Routine Assessment	Dia/Height:	8"
Use:	Sanitary Sewage Pipe	Material:	PVC
Drain Area:		Lining:	None
Category:	NA		
Comment:			

Location Details:		Direction of Survey:	Downstream
US MH:	M-907-009	DS MH:	M-907-009.1
		Total Length Surveyed (ft):	315.6

O&M Index:	2.00	O&M Quick:	2100	O&M Rating:	2.00
Structural Index:	2.00	Structural Quick:	2A00	Structural Rating:	22.00
Overall Index:	2.00	Overall Quick:	2A00	Overall Rating:	24.00

	Position	Code	Observation	Video (sec)	Grade
M-907-009					
	.0	AMH	Manhole	1	NA
	.0	MWL	Miscellaneous Water Level	63	NA
	14.4	MWLS(S01)	Miscellaneous Water Level Sag	134	S 2
	23.4	MWLS(F01)	Miscellaneous Water Level Sag	176	S 2
	66.4	MWLS(S02)	Miscellaneous Water Level Sag	338	S 2
	77.8	MWLS(F02)	Miscellaneous Water Level Sag	386	S 2
	110.1	MWLS(S03)	Miscellaneous Water Level Sag	514	S 2
	112.2	TF	Tap Factory	538	NA
	122.6	MWLS(F03)	Miscellaneous Water Level Sag	591	S 2
	220.7	MWLS(S04)	Miscellaneous Water Level Sag	904	S 2
	232.4	MWLS(F04)	Miscellaneous Water Level Sag	950	S 2
	242.5	MWLS	Miscellaneous Water Level Sag	990	S 2
	270.2	MWLS	Miscellaneous Water Level Sag	1084	S 2
	272.1	MGO	Miscellaneous General Observation	1132	NA
	283.5	MWLS	Miscellaneous Water Level Sag	1186	S 2
	286.0	MGO	Miscellaneous General Observation	1239	NA
	312.1	OBZ	Obstruction Other	1379	M 2
	315.6	AMH	Manhole	1503	NA
M-907-009.1					

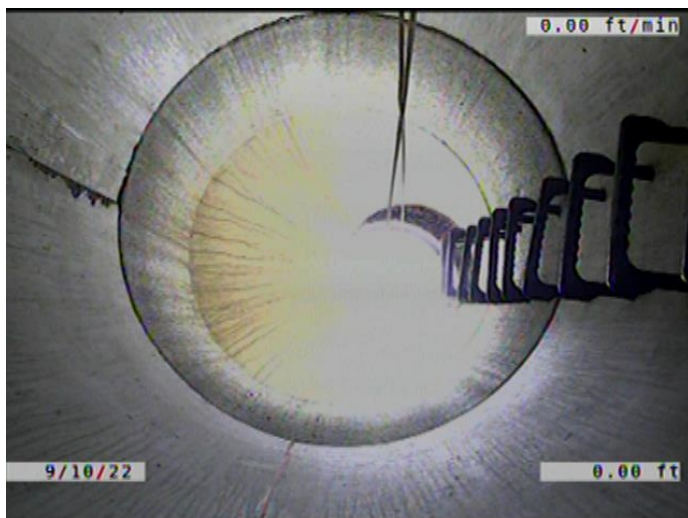

Code: **AMH**
 Description: **Manhole**

 Distance (ft): **.0**
 Structural Grade: **0**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks: **M-907-009**




Code: **MWL**
Description: **Miscellaneous Water Level**

Distance (ft): **.0**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index:
Within 8" of Joint: **NO**
Remarks:



Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **14.4**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index: **S01**
Within 8" of Joint: **NO**
Remarks:

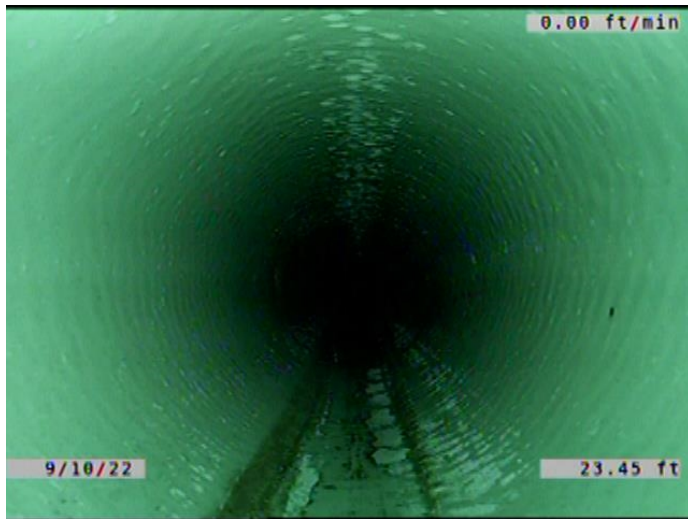

Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **23.4**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index: **F01**
Within 8" of Joint: **NO**
Remarks:




Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **66.4**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index: **S02**
Within 8" of Joint: **NO**
Remarks:




Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **77.8**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index: **F02**
Within 8" of Joint: **NO**
Remarks:

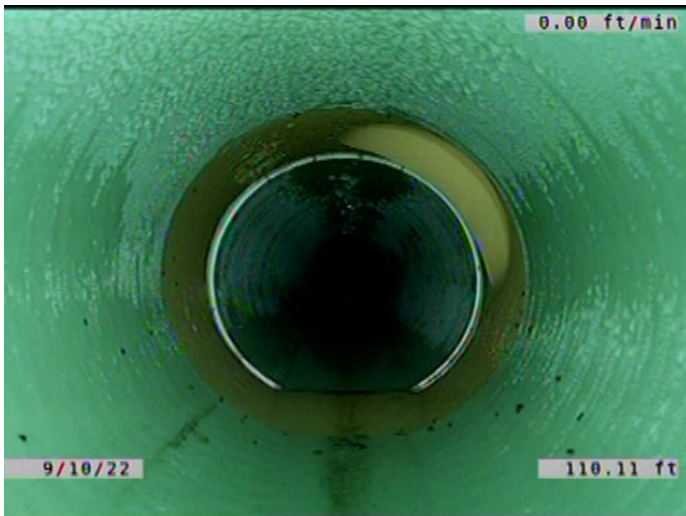


Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **110.1**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index: **S03**
Within 8" of Joint: **NO**
Remarks:

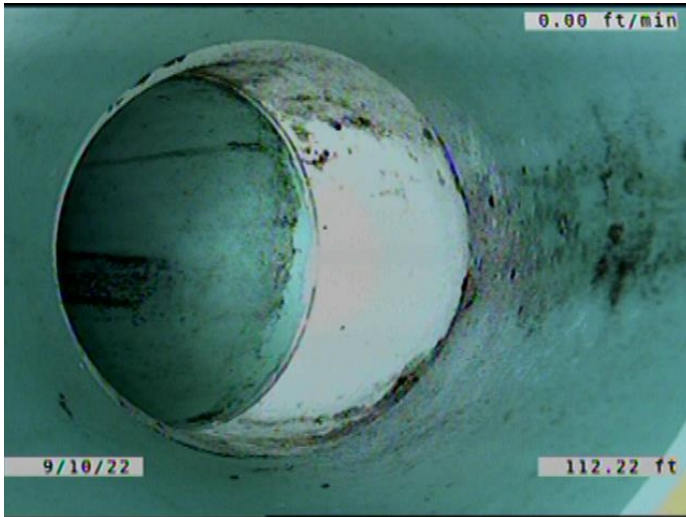


Code: **TF**
 Description: **Tap Factory**

Distance (ft): **112.2**
 Structural Grade: **0**
 O&M Grade: **0**
 Clock Start/From: **2**
 Clock To:
 1st Value: **4.000**
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

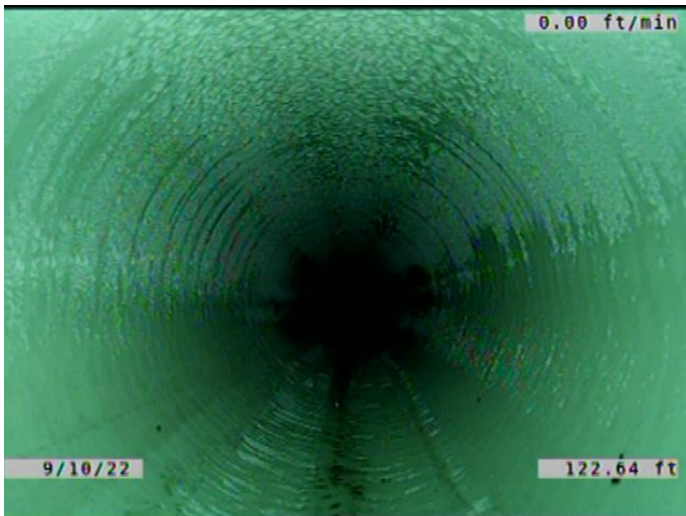


Code: **MWLS**
 Description: **Miscellaneous Water Level Sag**

Distance (ft): **122.6**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index: **F03**
 Within 8" of Joint: **NO**
 Remarks:

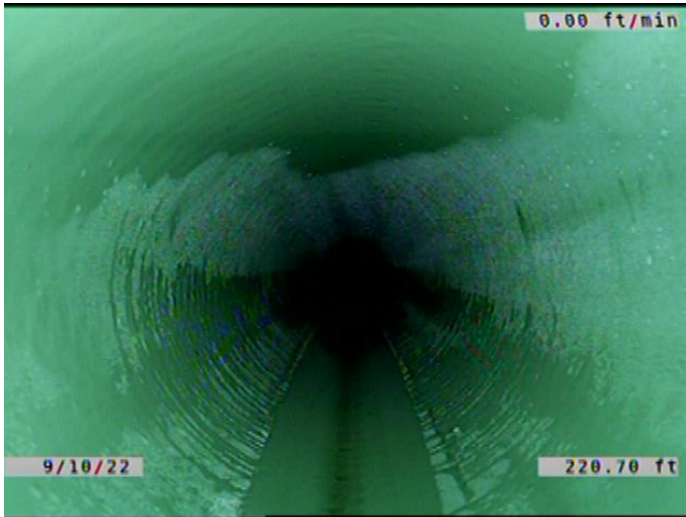


Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **220.7**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index: **S04**
Within 8" of Joint: **NO**
Remarks:

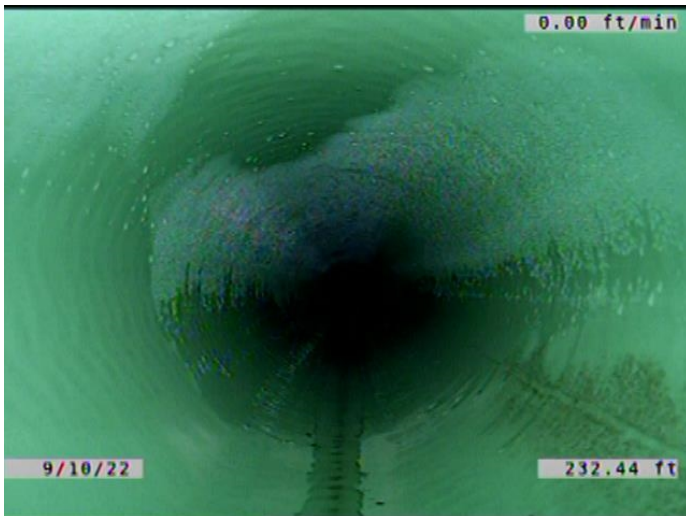

Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **232.4**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index: **F04**
Within 8" of Joint: **NO**
Remarks:

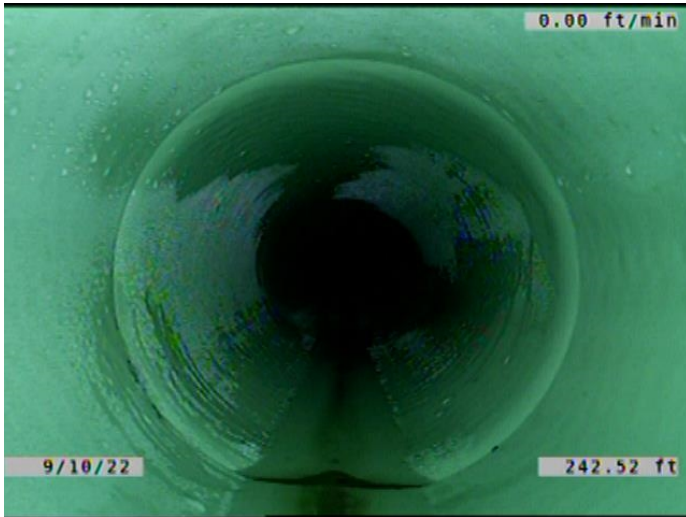


Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **242.5**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index:
Within 8" of Joint: **NO**
Remarks:



Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **270.2**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index:
Within 8" of Joint: **NO**
Remarks:

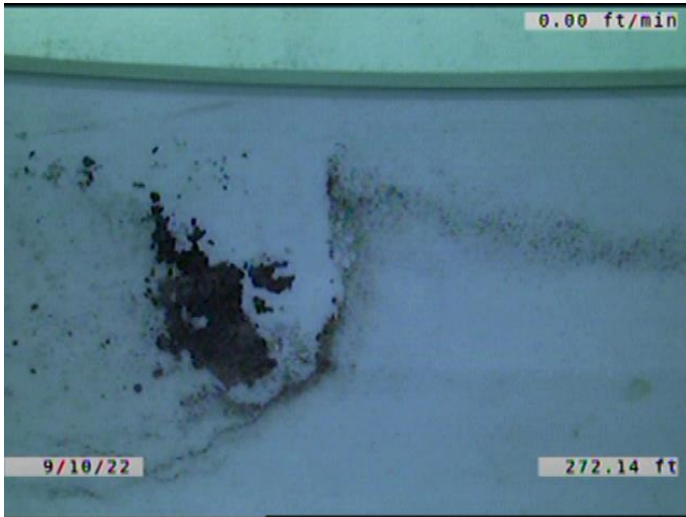


Code: **MGO**
Description: **Miscellaneous General Observation**

Distance (ft): **272.1**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **NO**
Remarks: **JOINT/ PIPES NOT PUSHED ALL THE WAY TOGETHER WHEN INSTALLED**




Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **283.5**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index:
Within 8" of Joint: **NO**
Remarks:

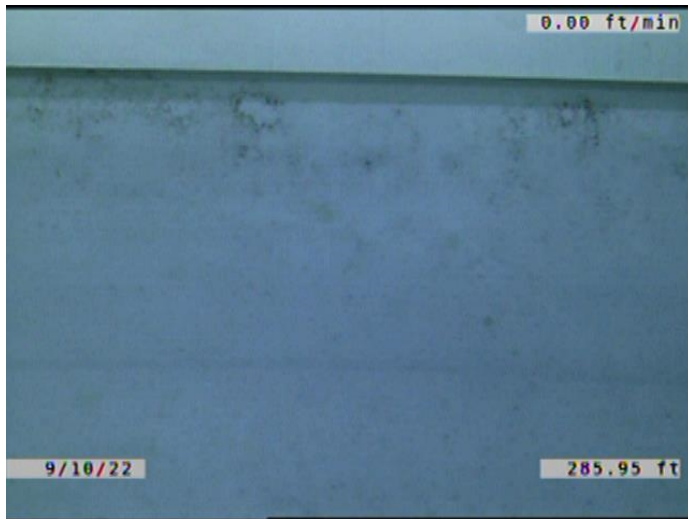

Code: **MGO**
 Description: **Miscellaneous General Observation**

Distance (ft): **286.0**
 Structural Grade: **0**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks: **JOINT/ PIPES NOT PUSHED ALL THE WAY TOGETHER WHEN INSTALLED**

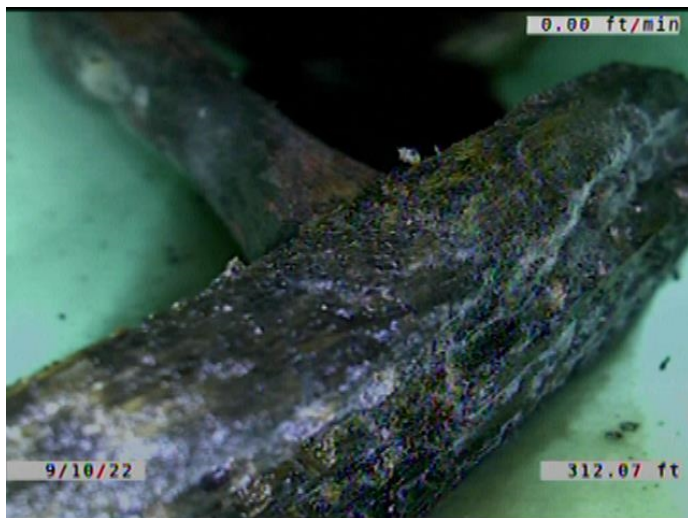

Code: **OBZ**
 Description: **Obstruction Other**

Distance (ft): **312.1**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **5**
 Clock To: **7**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks: **PAINT BRUSH HANDLE**



Code:	AMH
Description:	Manhole
Distance (ft):	315.6
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-907-009.1