## **Profile/Photo Observation Report**



Date: 12/06/2024 Weather: **PACP 7.0** Coding: Pipe Length (ft): 175.0 Owner: **City of Hobart** Pre Clean: **Heavy Cleaning** P.O.#: S. Bucklin PSR: P-507-078.1-078 YES502259 Surveyor:

Customer: City of Hobart Clean Date: 08/26/2024 Shape: C

Street: West 10th Street Flow Control: Not Controlled

City: Hobart, IN Year Renewed:
Location: Easement/Right of Way Tape/Media #:

Purpose: Sewer System Evaluation Survey (SS Dia/Height: 10"
Use: Sanitary Sewage Pipe Material: PVC

Drain Area: Lining: **None** 

Category: NA

Comment:

Location Details: Direction of Survey: Upstream

US MH: M-507-078.1 DS MH: M-507-078 Total Length Surveyed (ft): 178.0

2.00 2600 12.00 O&M Index: O&M Quick: O&M Rating: 2.00 2200 4.00 Structural Index: Structural Quick: Structural Rating: 2.00 2800 16.00 Overall Index: Overall Quick: Overall Rating:

	Position	Code	Observation	Video (sec)	Grade
507-	078				
	0.	AMH	Manhole	0	NA
ш	0.	MWL	Miscellaneous Water Level	12	NA
ш	1.5	MGO	Miscellaneous General Observation	20	NA
ш	5.7	DSZ(S01)	Deposits Settled Other	50	M 2
-	34.8	DSZ(F01)	Deposits Settled Other	180	M 2
	44.6	MWL	Miscellaneous Water Level	224	NA
ш	163.2	MWLS(S02)	Miscellaneous Water Level Sag	564	S 2
ш	163.2	MWL	Miscellaneous Water Level	571	NA
ш	174.2	MWLS(F02)	Miscellaneous Water Level Sag	610	S 2
ш	178.0	AMH	Manhole	729	NA
Ш					



Code: AMH Description: Manhole Distance (ft): .0 Structural Grade: 0 O&M Grade: 0 Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: NO M-507-078 Remarks:



Code: MWL

Description: Miscellaneous Water Level

Distance (ft): .0
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:


Value Percent: 5.000

Continuous Index:

Within 8" of Joint:

Remarks:

NO

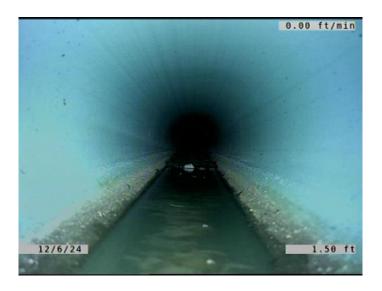

Code: MGO

Description: Miscellaneous General Observation

Distance (ft): 1.5
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: NO

Remarks: MANHOLE DOESNT HAVE A

**CHANNEL. HAD TO START IN THE PIP** 



Code: DSZ

Description: Deposits Settled Other

Distance (ft): 5.7
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 5
Clock To: 7

1st Value: 2nd Value:

Value Percent: 5.000
Continuous Index: S01
Within 8" of Joint: YES

Remarks: TP AND SOLIDS



Code: DSZ

Description: Deposits Settled Other

Distance (ft): 34.8
Structural Grade: 0

O&M Grade: 2

Clock Start/From: 5

Clock To: 7

1st Value:

Value Percent: 5.000
Continuous Index: F01
Within 8" of Joint: YES

2nd Value:

Remarks: TP AND SOLIDS



Code: MWL

Description: Miscellaneous Water Level

Distance (ft): 44.6
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 0.000

Continuous Index:

Within 8" of Joint:

Remarks:

NO



Code: MWLS

Description: Miscellaneous Water Level Sag

Distance (ft): 163.2
Structural Grade: 2
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 5.000
Continuous Index: S02
Within 8" of Joint: NO

Remarks:



Code: MWL

Description: Miscellaneous Water Level

Distance (ft): 163.2
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:


Value Percent: 5.000

Continuous Index:

Within 8" of Joint:

Remarks:

NO

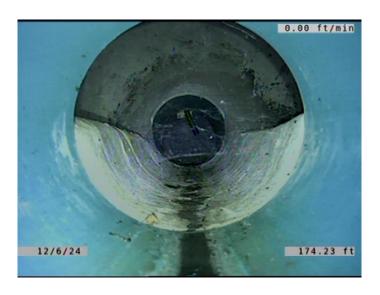

Code: MWLS

Description: Miscellaneous Water Level Sag

Distance (ft): 174.2
Structural Grade: 2
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 5.000
Continuous Index: F02
Within 8" of Joint: NO

Remarks:



Code: AMH
Description: Manhole

Distance (ft): 178.0
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO

Remarks: M-507-078.1